







ISO Class Rating Chart

For Commercial and Residential Structures

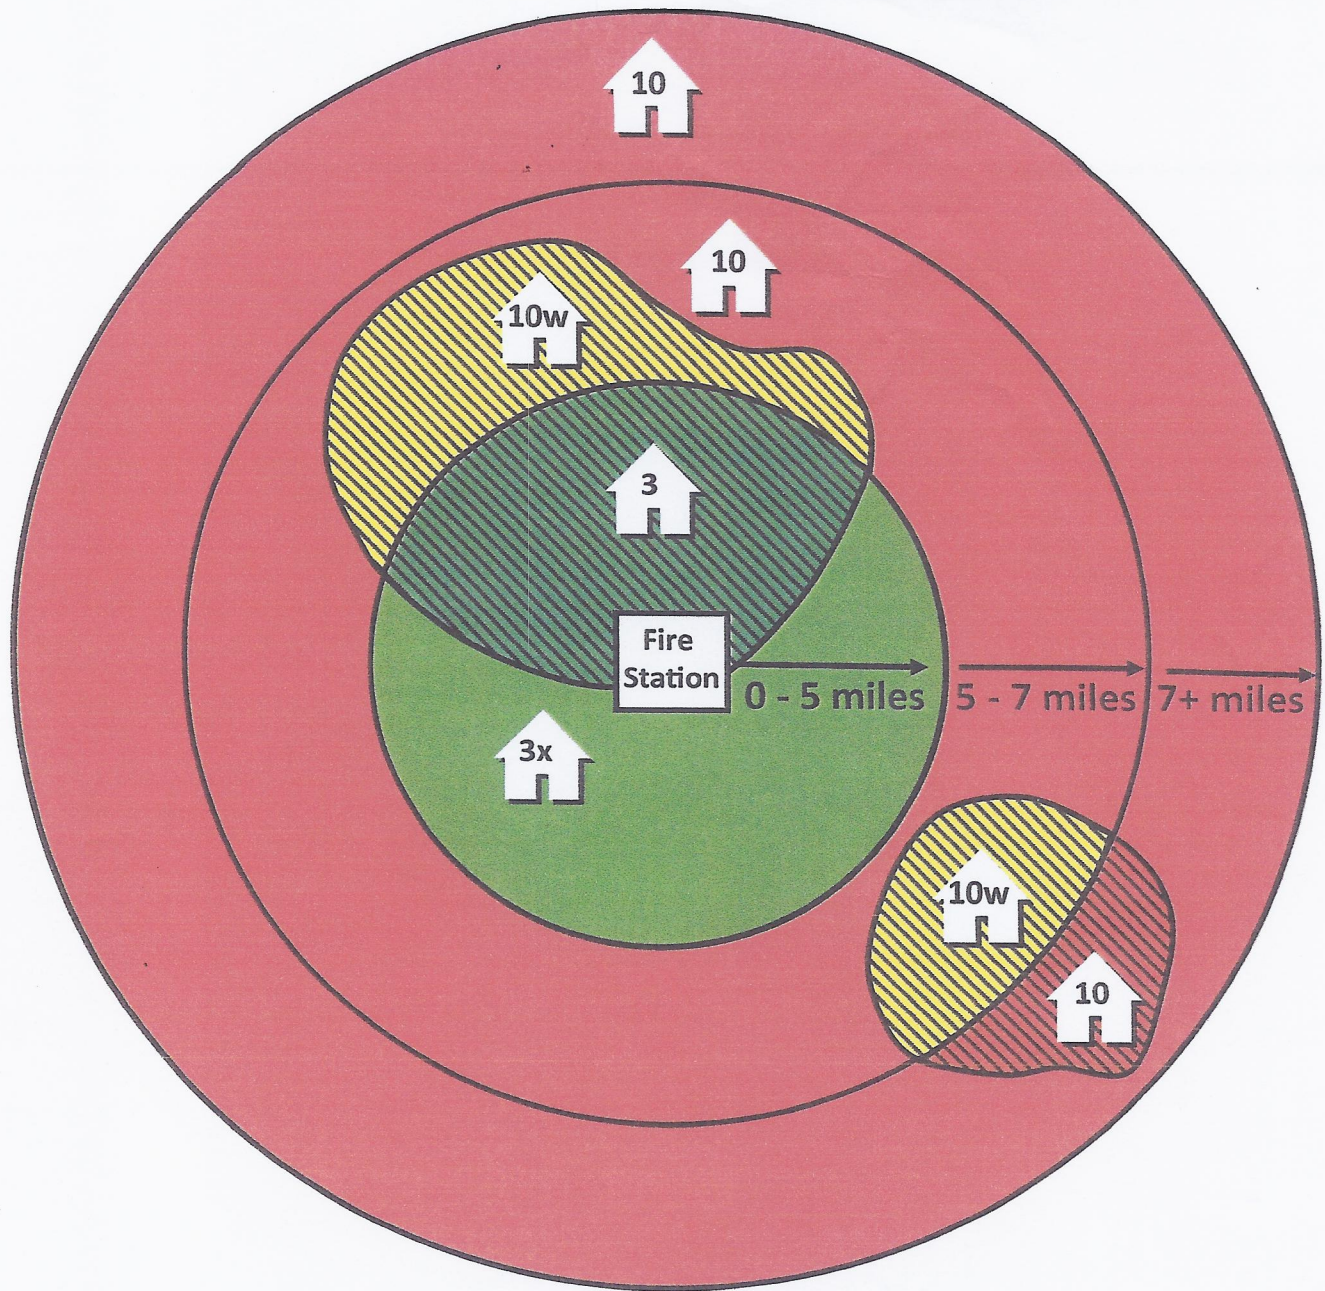

Hatch marks represent areas within 1000 feet of a creditable* water source

-  ISO class 3 - Within 5 road miles of a fire station and within 1000 feet of a creditable* water source
-  ISO class 3x - Within 5 road miles of a fire station but not within 1000 feet of a creditable* water source
-  ISO class 10w - Between 5 - 7 miles of a fire station and within 1000 feet of a creditable* water source
-  ISO class 10 - More than 5 miles of a fire station and not within 1000 feet of a creditable* water source
-  ISO class 10 - More than 7 miles from a fire station and within 1000 feet of a creditable* water source

* minimum water supply of 250 gallons per minute for a period of two hours